


PLUMBING FIXTURE SCHEDULE	
P-1	(HUB DRAIN - INDIRECT WASTE FUNNEL) SHALL BE A "ZURN" Z-326, 2" PIPE CONNECTION, DURA-COATED CAST IRON BODY AND BOTTOM OUTLET. CONTRACTOR SHALL VERIFY FINAL HEIGHT OF FUNNEL WITH EQUIPMENT THAT IS UTILIZING FUNNEL DRAIN AND VERIFY PROPER CLEARANCE PRIOR TO CONSTRUCTION. COORDINATE WITH EQUIPMENT MANUFACTURER.

- | GENERAL PLUMBING NOTES | |
|------------------------|--|
| 1. | Drawings are diagrammatic and shall not be scaled. Refer to architectural plans and elevations for exact location of all plumbing fixtures, equipment, etc.. Plumbing contractor shall furnish and install all items required for a complete and acceptable working installation. Contractor is responsible to install all fixtures and equipment in strict compliance with the manufacturer's installation instructions. This requirement is to supersede any details or information contained on these drawings. |
| 2. | All work and materials shall comply with the latest edition of the National, State, and all local codes and Ordinances having jurisdiction. |
| 3. | The plumbing contractor shall secure and pay all permit fees, inspections, and tests. |
| 4. | All work shall be coordinated with other trades to avoid interference with the progress of construction. |
| 5. | The plumbing contractor shall guarantee all materials and workmanship free from defects for a period of not less than (1) one year from date of acceptance. Correction of any defects shall be completed without additional charge and shall include replacement or repair of any other phase of the installation which may have been damaged thereby. |
| 6. | Verify location, size and inverts of all existing utilities prior to start of construction. Advise architect/engineer of any discrepancies. |
| 7. | Soil, wastes and vent piping shall be PVC #40 DMV. Waste and vent piping above slab shall be PVC, if approved by local authorities having jurisdiction, otherwise cast iron. PVC shall not be installed in A/C return or plenum or penetrate fire rated walls or floors. |

1 FLOOR PLAN - MECHANICAL
SCALE: 1/8"=1'-0"

RELOCATED EXISTING TENANT SIGN.
RELOCATE ALL EXISTING ELECTRICAL AND RECONNECT
TO EXISTING SIGN CIRCUIT AT FINAL LOCATION
SHOWN ON PLANS. CONTRACTOR TO VERIFY EXISTING
CONDITIONS AND REQUIREMENTS PRIOR TO CONSTRUCTION.

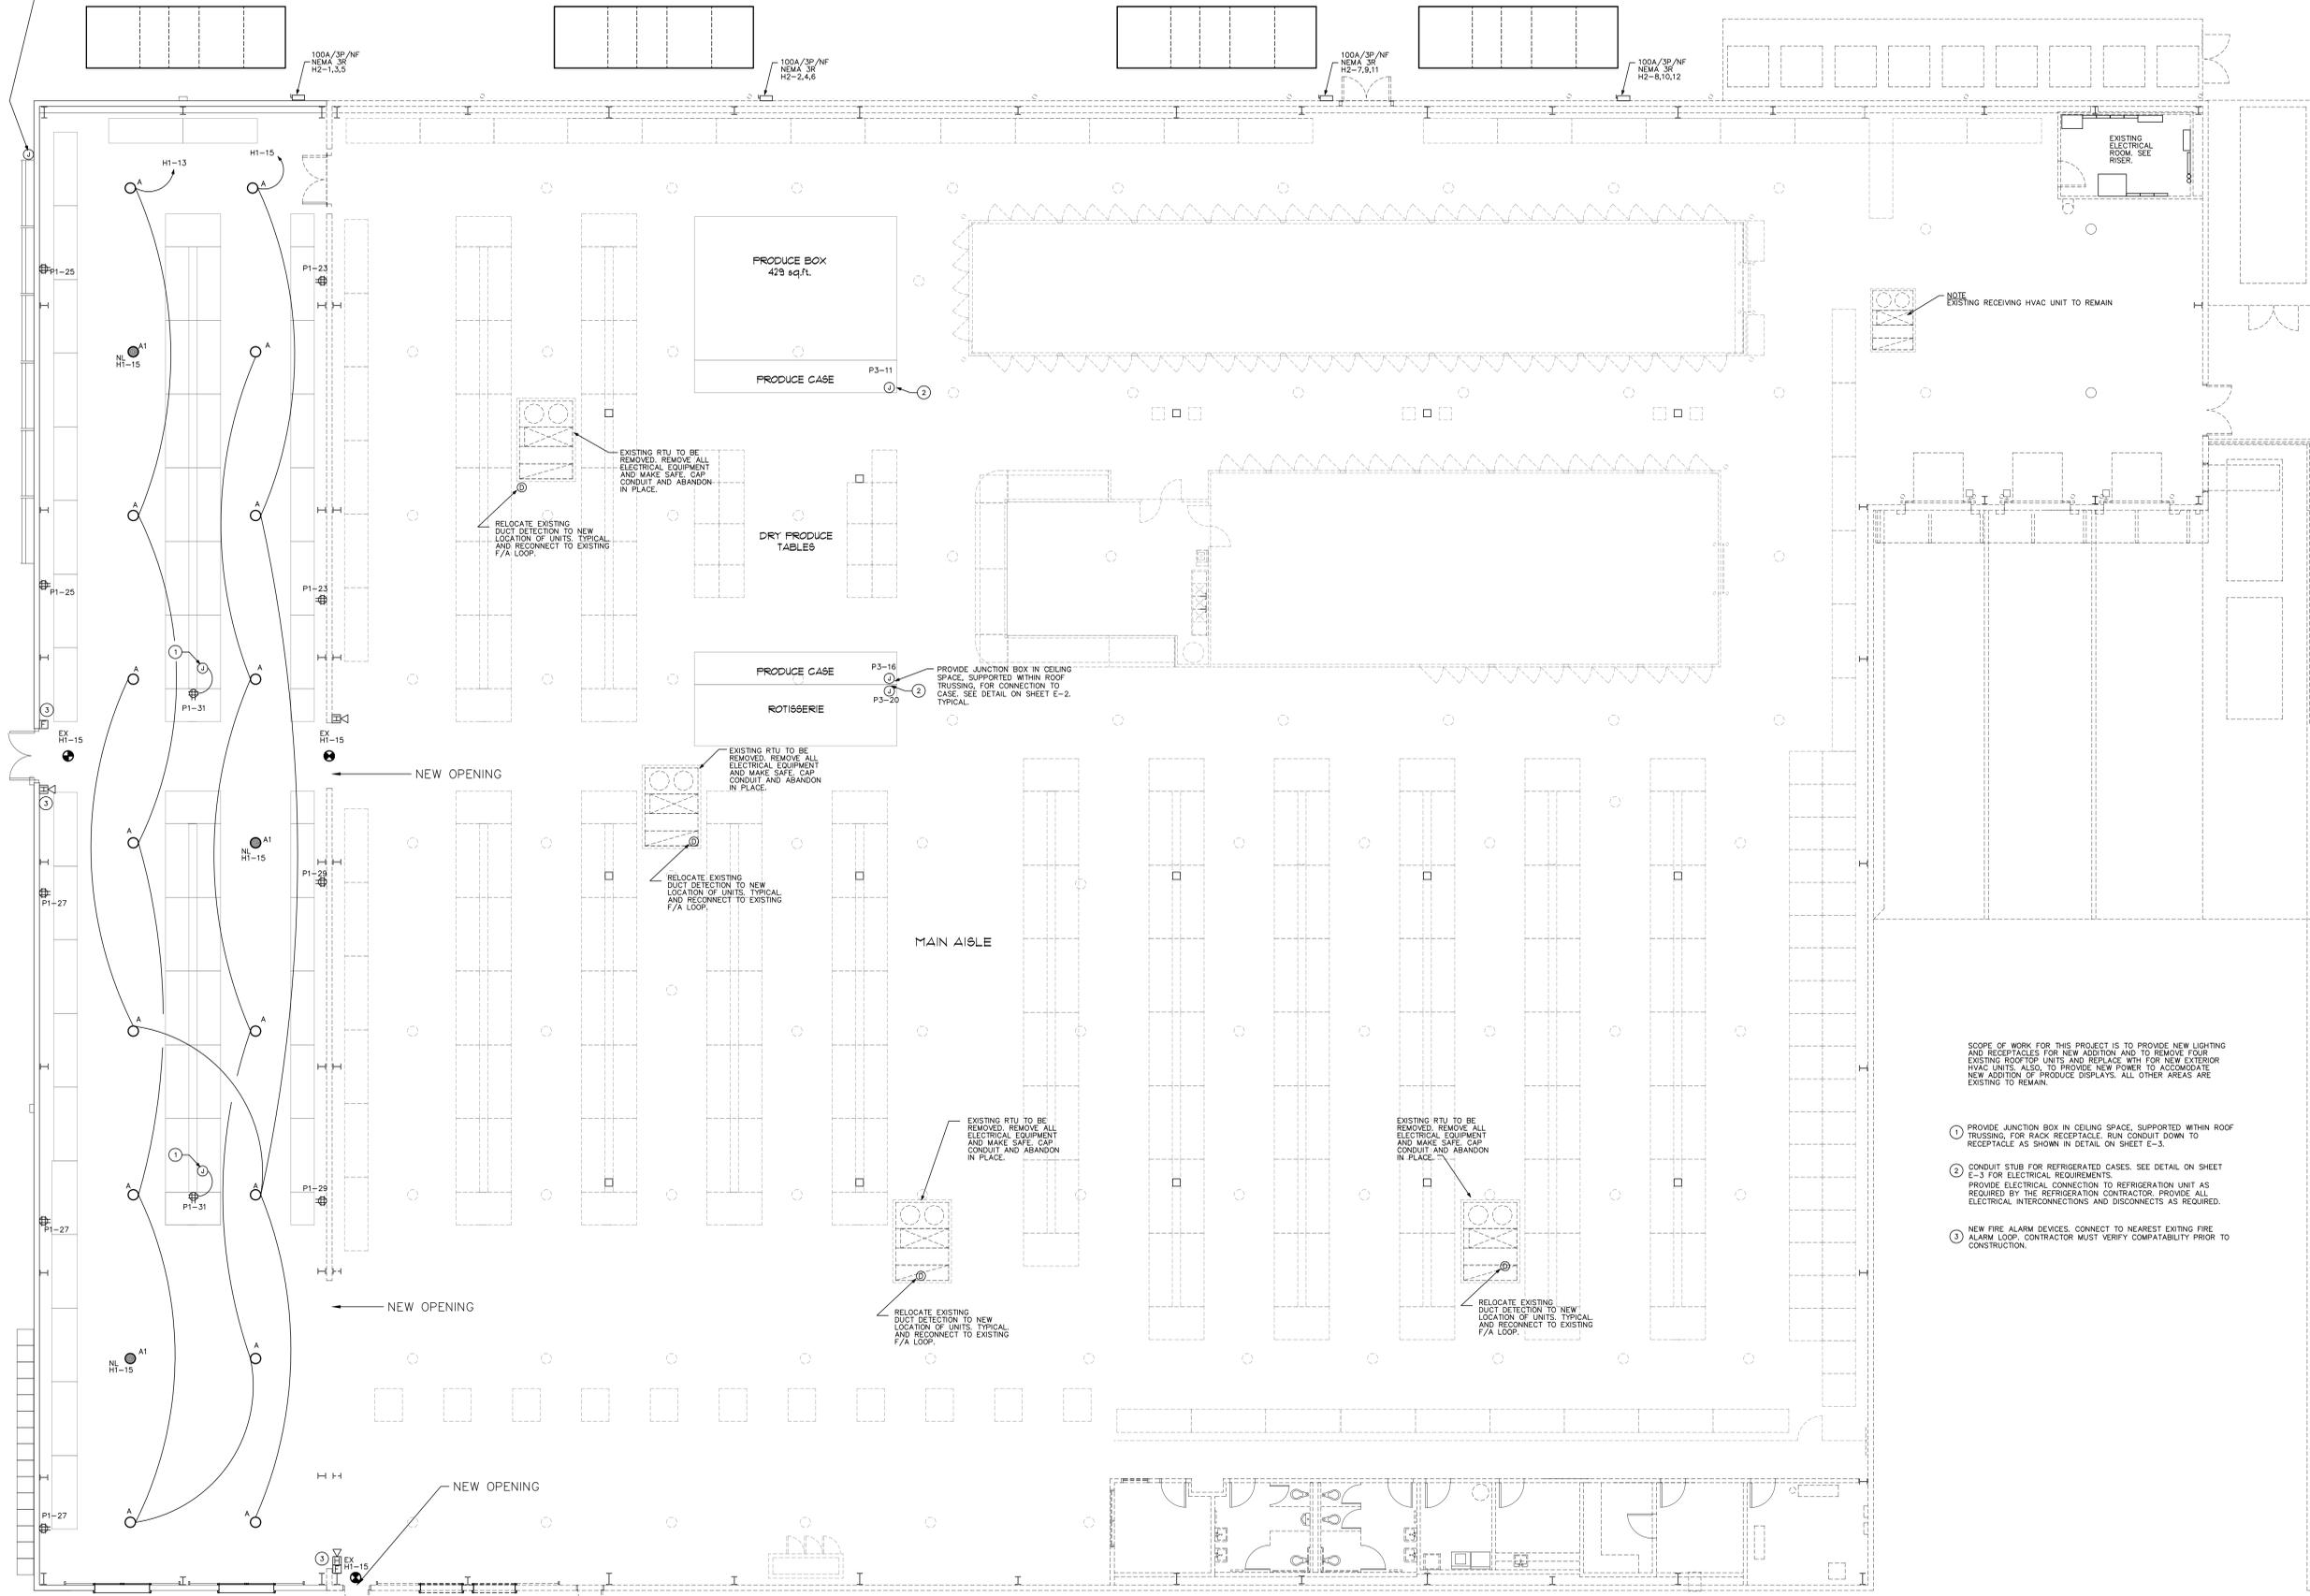

- SCOPE OF WORK FOR THIS PROJECT IS TO PROVIDE NEW LIGHTING AND RECEPTACLES FOR NEW ADDITION AND TO REMOVE FOUR EXISTING ROOF TOP UNITS AND REPLACE WITH FOUR NEW EXTERIOR HVAC UNITS. ALSO, TO PROVIDE NEW POWER TO ACCOMMODATE NEW ADDITION OF PRODUCE DISPLAYS. ALL OTHER AREAS ARE EXISTING TO REMAIN.
- ① PROVIDE JUNCTION BOX IN CEILING SPACE, SUPPORTED WITHIN ROOF TRUSSING, FOR RACK RECEPTACLE RUN CONDUIT DOWN TO RECEPTACLE AS SHOWN IN DETAIL ON SHEET E-3.
 - ② CONDUIT STUB FOR REFRIGERATED CASES. SEE DETAIL ON SHEET E-3 FOR ELECTRICAL REQUIREMENTS. PROVIDE ELECTRICAL CONNECTION TO REFRIGERATION UNIT AS REQUIRED BY THE REFRIGERATION CONTRACTOR. PROVIDE ALL ELECTRICAL INTERCONNECTIONS AND DISCONNECTS AS REQUIRED.
 - ③ NEW FIRE ALARM DEVICES. CONNECT TO NEAREST EXISTING FIRE ALARM LOOP. CONTRACTOR MUST VERIFY COMPATIBILITY PRIOR TO CONSTRUCTION.

1 ELECTRICAL FLOOR PLAN
SCALE: 1/8"=1'-0"

