



5 TYPICAL SECTION THRU TRENCH
NO SCALE



4 TYPICAL PULLBOX PLAN
SCALE: 3/8"=1'-0"

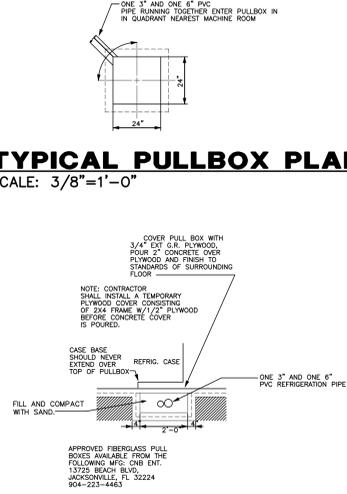

3 TYPICAL SECTION THRU PULLBOX
SCALE: 3/8"=1'-0"

GENERAL NOTES



- ALTERATIONS TO EXISTING WORK BEING OF SUCH NATURE THAT ALL FACETS OF THE WORK BEING IMPOSSIBLE TO DETAIL AND SPECIFY. IT IS THEREFORE, THE RESPONSIBILITY OF THE CONTRACTOR TO CAREFULLY EXAMINE THE BUILDING AND FAMILIARIZE HIMSELF WITH THE CONDITIONS AND RELATE THESE CONDITIONS TO THE SCOPE OF THE PROPOSED NEW WORK.
- IT IS RECOMMENDED THAT THE SUB-CONTRACTOR ARRANGE A PRE-JOB CONFERENCE WITH THE WINN-DIXIE MAINTENANCE SUPERINTENDENT FOR REVIEW AND CONTACT. MR. BOB MEADOWS, (500) 632-8263.
- CONTRACTOR SHALL VERIFY LOCATION OF EXISTING TRENCHES AND/OR PULL-BOXES TO BE RE-USED.
- ALL DIMENSIONS ARE CUMULATIVE AND ARE TAKEN FROM FINISH FACE OF WALLS, EXCEPT AS NOTED OTHERWISE.
- NEW PLASTIC PIPE SHALL HAVE CONTINUOUS SLOPE FROM PULL-BOX TO TRENCH.
- CONTRACTOR IS CAUTIONED NOT TO POUR ANY PORTION OF CONCRETE FLOOR SLAB UNTIL UNDERGROUND UTILITIES ARE CHECKED. ALLOW A MIN. OF TWO WEEKS PRIOR TO CHECKING.
- FILL ALL ABANDONED TRENCHES AND PULL-BOXES WITH CLEAN WHITE SAND AND COVER WITH 2" WEAK CONCRETE AND FINISH AS REQUIRED. SEE DETAIL THIS SHEET.
- ALL EXISTING TRENCHES, PULL-BOXES, CONDUIT, REFRIGERATION PIPING, ETC. THAT WILL NOT BE RE-USED SHALL BE CONCEALED (PLUGGED AND/OR REMOVED), WITHIN WALLS, FLOOR ETC., AND AREA PREPARED TO MATCH ADJACENT AREA, WHETHER INDICATED ON DRAWINGS OR DISCOVERED DURING CONSTRUCTION.
- GENERAL CONTRACTOR IS TO SAW-CUT EXISTING FLOOR SLAB TO MAKE TRENCHES AS REQUIRED. RUN NEW REFRIGERATION TUBING, PLUMBING LINES AND ELECTRICAL CONDUIT IN THESE TRENCHES. THE GENERAL CONTRACTOR IS TO COORDINATE ALL TRADES AND SEE THAT ALL WORK IS PLACED INSIDE THESE CUTS, AND THEN RESPONSIBLE FOR REPAIRING ALL CUTS, PREPARING CONCRETE TO RECEIVE NEW FLOOR FINISH.
- THE CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS WITH THE DRAWINGS BEFORE PROCEEDING WITH ANY WORK. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ESTABLISH DIMENSIONAL CONTROL LINES FOR THE SUBCONTRACTORS TO CHECK THEIR LAYOUT WORK RELATIVE TO FUTURE WALLS AND THE WORK OF OTHER SUBCONTRACTORS. THE CONTRACTOR SHALL REPORT ANY PLAN CONFLICTS OR DISCREPANCIES TO THE ARCHITECT FOR CLARIFICATION. ANY REMEDIAL WORK REQUIRED SHALL NOT BE ENTITLED THE CONTRACTOR OR SUBCONTRACTOR ADDITIONAL COMPENSATION.
- IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO VERIFY ALL CASE ROUGH-IN DIMENSIONS WITH WINN DIXIE. CONTRACTOR SHALL LAY-OUT ALL ROUGH-INS FOR APPROVAL BY WINN-DIXIE PRIOR TO ANY WORK.
- LOCATIONS FOR THE EXISTING REFRIGERATION TUBING, PULL-BOXES, ETC. ARE BASED UPON THE PARTIAL ORIGINAL CONSTRUCTION DOCUMENTS SUPPLIED BY WINN-DIXIE. CONTRACTOR SHALL MODIFY LAYOUT AS REQUIRED DUE TO ANY ENCOUNTERED DEVIATIONS, TO PROVIDE COMPLETE TUBING AND PULL-BOX INSTALLATION, AT NO ADDITIONAL COST TO WINN-DIXIE.

GENERAL NOTE

CONTRACTOR TO VERIFY EXISTING SYSTEMS AND EQUIPMENT SIZES. THESE PLANS ARE PREPARED BASED ON OUR UNDERSTANDING OF WHAT IS EXISTING AT THIS TIME WITHIN THE BUILDING. IF ANY DEVIATIONS ARE NOTED DURING INITIAL SURVEYS OR CONSTRUCTION, CONTRACTOR IS TO NOTIFY ENGINEER IMMEDIATELY FOR CORRECTIVE ACTION.


SPECIFIC REFRIGERATION NOTES

- EXISTING PULL BOX SHALL REMAIN AS CONNECTED AND BE RE-USED BY NEW EQUIPMENT.
- NEW PULL BOX CUT INTO EXISTING TUBING AT THIS LOCATION.
- NEW REFRIGERANT PIPING SHALL ROUTE UP IN BACK SALES WALL, OFFSET ACROSS CEILING TO NEW MACHINE ROOM AREA.
- EXISTING PULL BOX SHALL BE ABANDONED IN PLACE.
- CONTRACTOR SHALL ABANDON EXISTING REFRIGERANT TRENCHES IN THIS AREA. CONTRACTOR SHALL COORDINATE ALL NEW REFRIGERANT TRENCHES WITH EXISTING. REMOVE EXISTING TRENCHES AS REQUIRED TO ACCOMMODATE NEW TRENCHES.
- EXISTING PULL BOX SHALL BE EXTENDED AS REQUIRED TO ACCOMMODATE NEW REFRIGERATION EQUIPMENT.
- CONNECT TO EXISTING PULLBOX IN THIS AREA. CONTRACTOR SHALL VERIFY EXACT LOCATION PRIOR TO CONSTRUCTION.

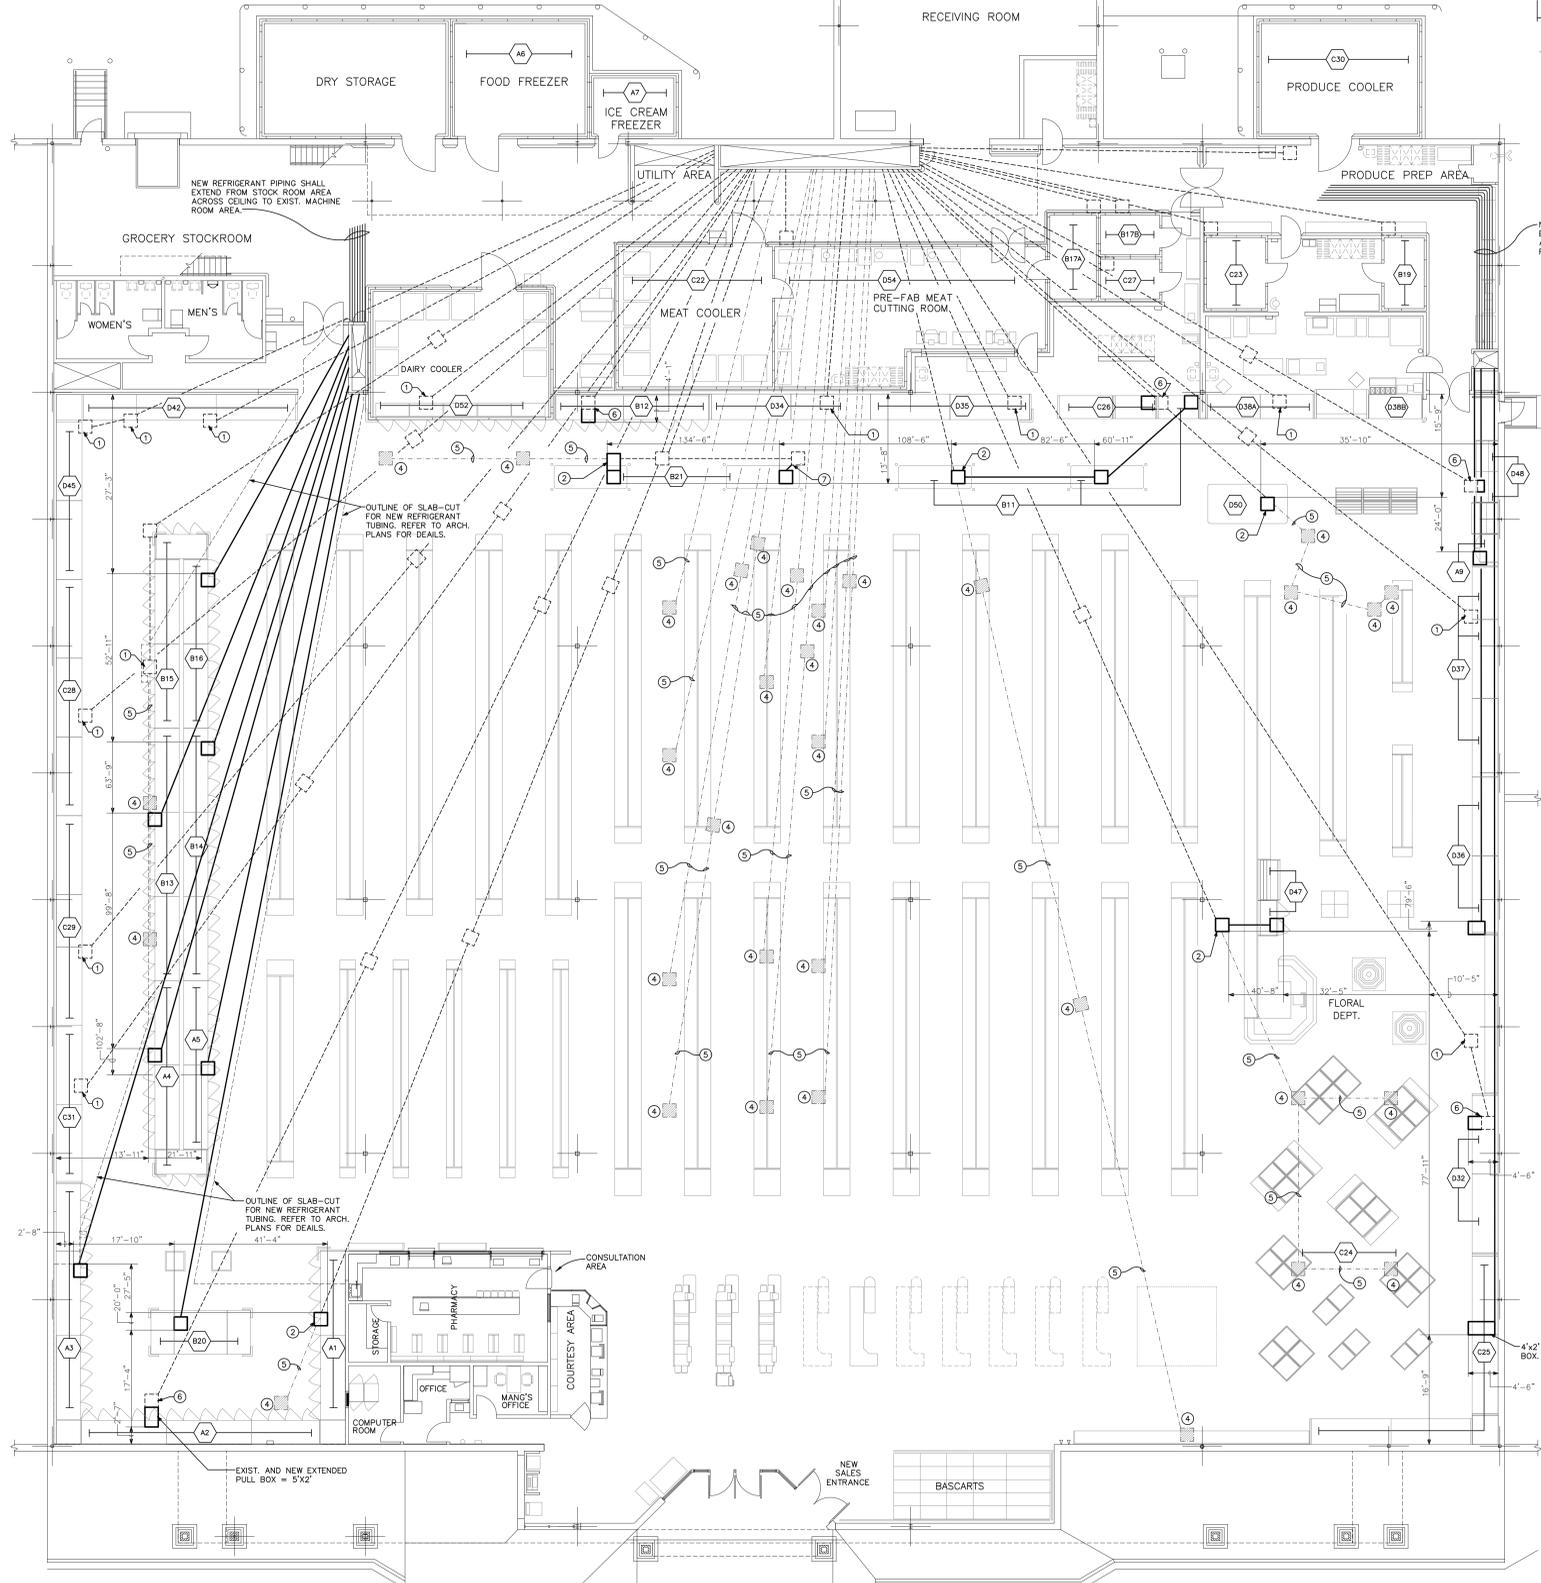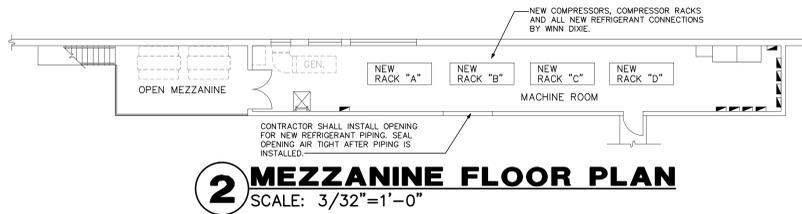

1 FLOOR PLAN - REFRIGERATION TUBING
SCALE: 3/32"=1'-0"

- LEGEND**
- EXISTING SCHEDULE 40 PIPE
 - NEW ONE 3" AND ONE 6" SCHEDULE 40 PIPE
 - EXISTING 24"x24"x12" DEEP CONCRETE PULLBOX TO REMAIN AS CONNECTED.
 - NEW 24"x24"x12" DEEP CONCRETE PULLBOX
 - NEW REFRIGERATION SYSTEM
 - EXIST. REFRIGERATION SYSTEM TO REMAIN
 - CUMULATIVE DIMENSIONS VERIFY ALL DIMENSIONS W/WINN DIXIE REPRESENTATIVE BEFORE BEGINNING ANY WORK
 - EXISTING REFRIGERANT TUBING SHALL BE ABANDONED IN PLACE.

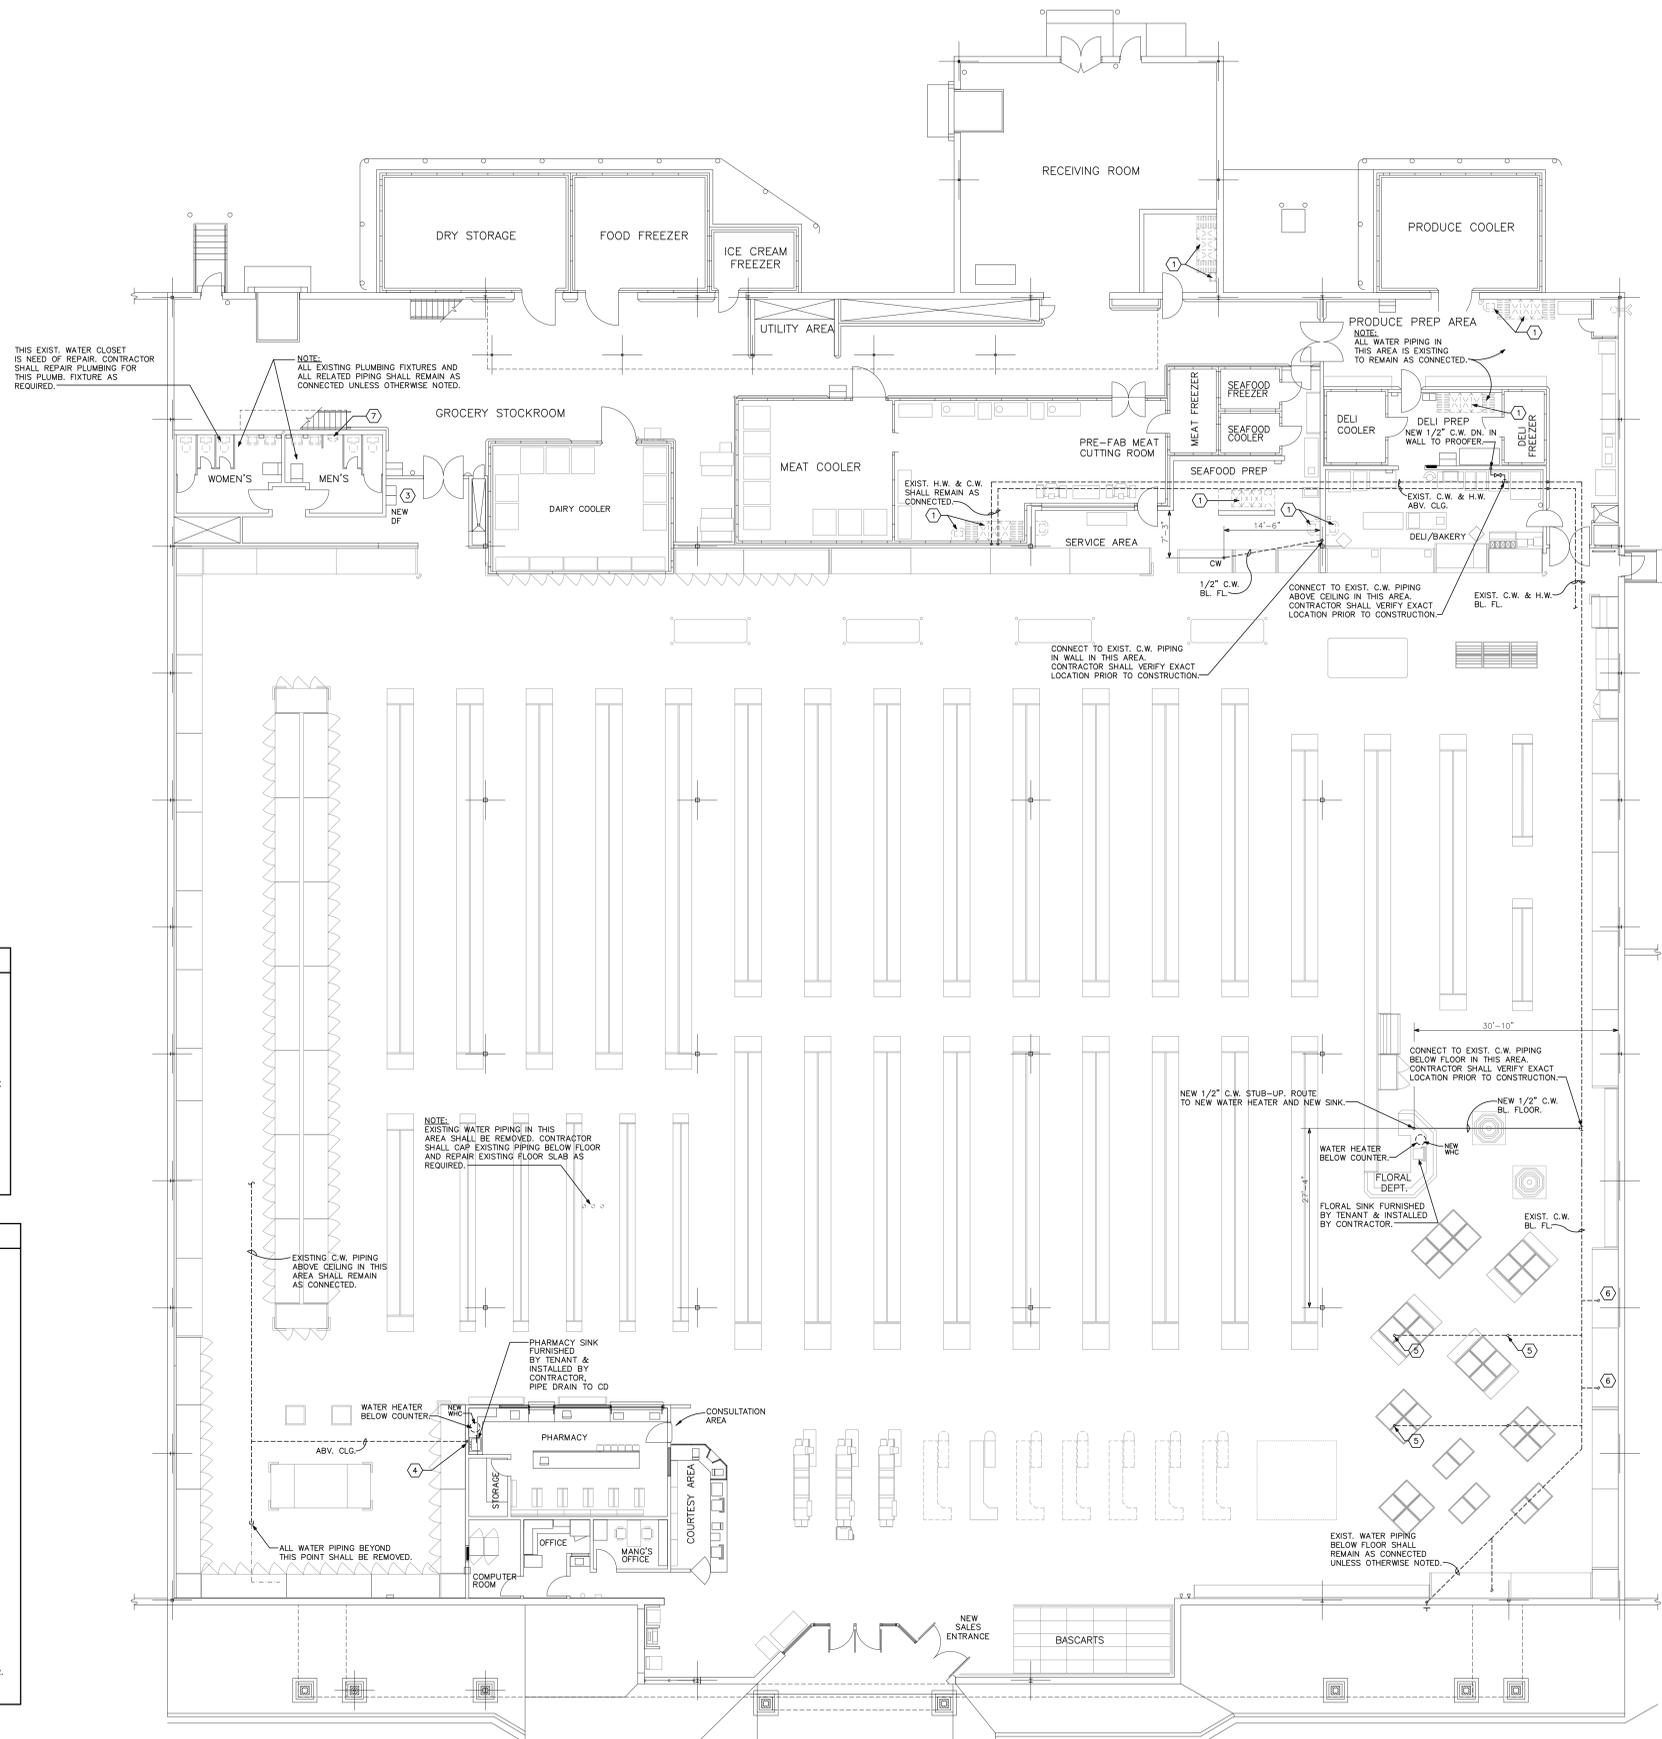

- SPECIFIC NOTES**
1. EXISTING SINK AND ALL RELATED PIPING SHALL REMAIN AS CONNECTED.
 2. NEW URINAL IN THIS AREA. CONTRACTOR SHALL CONNECT A NEW 3/4" C.W. LINE TO NEW URINAL. CONNECT TO EXISTING C.W. PIPING IN WALL AT THIS LOCATION. CONTRACTOR SHALL VERIFY EXACT LOCATION PRIOR TO CONSTRUCTION.
 3. EXISTING DRINKING FOUNTAIN IN THIS AREA SHALL BE REPLACED BY A NEW H.A.O. COMBINATION ELECTRIC WATER COOLER. CONTRACTOR SHALL RECONNECT EXISTING C.W. PIPING TO NEW ELECTRIC WATER COOLER AS REQUIRED.
 4. NEW PHARMACY SINK IN THIS AREA. CONTRACTOR SHALL CONNECT NEW 1/2" C.W. LINE TO NEW SINK AND WATER HEATER. CONNECT TO EXISTING C.W. PIPING IN WALL AT THIS LOCATION. CONTRACTOR SHALL VERIFY EXACT LOCATION PRIOR TO CONSTRUCTION. ROUTE NEW 1/2" H.W. LINE FROM W.H. TO SINK AS REQUIRED.
 5. EXISTING C.W. STUB-UP IN THIS AREA SHALL BE CAPPED BELOW FLOOR. CONTRACTOR SHALL REPAIR FLOOR SLAB AS REQUIRED.
 6. EXISTING C.W. STUB-UP IN THIS AREA SHALL REMAIN AS CONNECTED.
 7. EXISTING URINAL IN THIS AREA SHALL BE RELOCATED TO A NEW UP HEIGHT OF 17". CONTRACTOR SHALL RECONNECT EXISTING PLUMBING AS REQUIRED.

- WATER DISTRIBUTION NOTES**
1. N/A
 2. ALL NEW WATER PIPING SHALL BE COPPER OR CPVC.
 3. NEW WATER LINES SHALL NOT RUN UNDER COOLERS OR FREEZERS.
 4. PROVIDE AND INSTALL STOPS FOR WATER SUPPLIES AT EACH NEW FIXTURE.
 5. PROVIDE AND INSTALL ADEQUATE WATER HAMMER AND ANTI-SIPHON PROTECTION ON ALL NEW FAUCETS. SIZE IN ACCORDANCE WITH LOCAL CODES.
 6. N/A
 7. THE CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS WITH THE DRAWINGS BEFORE PROCEEDING WITH ANY WORK. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ESTABLISH DIMENSIONAL CONTROL LINES FOR THE SUBCONTRACTORS TO CHECK THEIR LAYOUT WORK RELATIVE TO FUTURE WALLS AND THE WORK OF OTHER SUBCONTRACTORS. THE CONTRACTOR SHALL REPORT ANY PLAN CONFLICTS OR DISCREPANCIES TO THE ARCHITECT FOR CLARIFICATION. ANY REMEDIAL WORK REQUIRED SHALL NOT BE ENTITLED THE CONTRACTOR OR SUBCONTRACTOR ADDITIONAL COMPENSATION.
 8. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO VERIFY ALL CASE ROUGH-IN DIMENSIONS. CONTRACTOR SHALL LAY-OUT ALL ROUGH-INS FOR APPROVAL BY WINN-DIXIE AND CASE MANUFACTURER PRIOR TO ANY WORK. DIMENSIONS SHOWN MAY OR MAY NOT BE ACCURATE FOR THE SPECIFIC CASES TO BE SUPPLIED ON THIS PROJECT.
 9. LOCATIONS FOR EXISTING DW, CW, & HW PIPING & STUB-UPS, ETC. ARE BASED UPON ORIGINAL CONSTRUCTION DOCUMENTS SUPPLIED BY WINN-DIXIE. CONTRACTOR SHALL MODIFY LAYOUT AS REQUIRED DUE TO ANY ENCOUNTERED DEVIATIONS, TO PROVIDE COMPLETE INSTALLATION, AT NO ADDITIONAL COST TO WINN-DIXIE.
- SPRINKLER NOTE:**
ANY MODIFICATION, ADJUSTMENT, OR RELOCATION TO THE SPRINKLER SYSTEM BE BY THE CONTRACTOR.

1 FLOOR PLAN - SUPPLY PIPING
SCALE: 3/32"=1'-0"



PLUMBING LEGEND & SCHEDULE

1	DCD	"DCD" DRAIN RECEIVES CONDENSATE WATER FROM REFRIGERATION COILS.
2	CD	"CD" DRAIN RECEIVES CONDENSATE WATER FROM COOLERS, FREEZERS & CUTTING ROOM REFR. COILS
3	VFD	"VFD" DRAINS, NEW REFRIGERATION TUBING CHASE--JOSAM NO.39970 OR JAY R. SMITH NO.2280 OR ZURN NO. Z560V WITH VALVE ASSEMBLY NO. 7080 OR WADE W-1643-Y-SC193
4	FD	"FD" DRAINS JOSAM NO.32120-2 OR JAY R. SMITH NO.2110-B-PB OR WADE W-1313-27-2 OR ZURN NO. ZB550-Y ALL FLOOR DRAINS SHALL BE PROVIDED WITH A SEDIMENT BUCKET.
5	SFD	"SFD" STAINLESS STEEL FLOOR DRAIN JOSAM 766.200.000.03(316L)W/780.200.000.055-(WD MODIFIED)
6		TANKLESS WATER HEATER SHALL BE A CHROMOMITE MODEL S-461L, 4.6 KW TANKLESS WATER HEATER. MOUNTED BELOW COUNTER.
7	SW	2" SAFEWASTE DRAIN.
8	F 5/8"	FLOOR CLEANOUT--JAY R SMITH NO. 56040-2 OR WADE W-6030-HD OR ZURN Z-1400-T-HD OR JOSAM 56040-2
9	VTR	VENT THROUGH ROOF.
10	OMIT	
11	OMIT	
12	OMIT	
13	OMIT	
14	OMIT	
15	OMIT	
16	OMIT	
17	o CW	COLD WATER STUB--UP. CONNECT TO FIXTURES SHOWN (1/2" LINE MINIMUM)
18	o HW	HOT WATER STUB--UP. CONNECT TO FIXTURES SHOWN (1/2" LINE MINIMUM)
19	OMIT	
20	---	SOIL, WASTE OR LEADER PIPE
21	---	COLD WATER LINE
22	---	HOT WATER LINE
23	---	VENT LINE
24	OMIT	
25	OMIT	
25a	OMIT	
26	OMIT	
26a	OMIT	
27	OMIT	
28	PHS	PEDESTAL HAND SINK LOAD KING NO. NH-1014-WA-P
29		HANDICAPPED ELECTRIC WATER COOLER COMBINATION HI/LO SHALL BE AN OASIS SPLIT LEVEL MODEL PRAMSL, 7.8 GPM, 5.0 FLA AT 120 VOLT WITH A 1/2 HP COMPRESSOR.
30	OMIT	
31	OMIT	
32	OMIT	
33	OMIT	
34	OMIT	
35	OMIT	
36	WHC	WATER HEATER ELECTRIC AS MANUFACTURED RHEEM MANUFACTURING CO. MODEL EGSP-6 6 GALLON, 2000 WATT HEATING ELEMENT, 120/1 VOLT, 16.7 FLA, GLASS LINED, FOAM INSULATED ASHRAE 90A-1980 APPROVED, UL APPROVED, AOSMITH DEL-65-2KW
37	OMIT	
38	HS	HAND SINK FOR-- DELI, BAKERY, SEAFOOD AND MEAT SERVICE--SEE DETAIL AND INFORMATION THIS DRAWING
39	OMIT	
40	OMIT	
41	OMIT	
42	OMIT	
43	OMIT	
44	OMIT	
45	OMIT	
46	OMIT	

* OR EQUIVALENT FROM AMERICAN STANDARD OR KOHLER

NOTES TO PLUMBERS


1. PLUMBING CONTRACTOR SHALL FURNISH & INSTALL COMPLETE ALL "OPEN TYPE" PLUMBING ABOVE FLOOR WHICH INCLUDES HOOD-UP FROM DISPLAY CASES, REFRIGERATION COILS, CONDENSERS, ETC. TO DRAINS.
2. CARE IS TO BE USED WHEN LAYING PIPE OVER FILL. FILL IS TO BE COMPACTED MECHANICALLY. NO-HUB PIPE MAY BE USED, PVC MAY BE USED FOR CONDENSATE DRAIN LINES.
3. SLOPE OF ALL NEW DRAIN LINES SHALL BE 1/4" FALL PER FOOT (PREFERRED) 1/8" PER FOOT (MIN). STORE DESIGN DEPARTMENT TO BE NOTIFIED IF PREFERRED SLOPE CAN NOT BE ACHIEVED.
4. NEW MAIN DRAIN LINES SHALL BE MINIMUM OF 4" DIAMETER. NEW BRANCH LINES TO BE 3" IN DIA.
5. ALL NEW WATER LINES TO BE COPPER.
6. WATER LINES SHALL NOT BE RUN UNDER ANY COOLERS OR FREEZERS.
7. ALL NEW DRAINS SHALL BE "P" TRAPPED AT THEIR ORIGIN (UNLESS PROHIBITED BY LOCAL CODES).
8. N/A
9. ALL NEW DRAIN STUBS SHALL BE CHECKED BY "WINN-DIXIE" PERSONNEL AS TO EXACT LOCATION BEFORE CONCRETE FLOOR SLAB IS POURED.
10. THE VARIOUS DRAIN MAKE-UPS AS SHOWN & DESCRIBED HERE-IN ARE FUNCTIONALLY MOST DESIRABLE. IF SUCH ARE NOT LOCALLY ACCEPTABLE, THE CONTRACTOR SHALL INSTALL OTHER DRAINS AS MAY BE REQUIRED. HE SHALL INSTALL ANY VENTS WHICH MAY BE LOCALLY REQUIRED WHETHER SHOWN ON PLANS OR NOT. THE ENTIRE PLUMBING SYSTEM SHALL CONFORM WITH LOCAL AUTHORITY REQUIREMENTS.
11. ANY SYSTEM PROPOSED OR CHANGED FROM THE SYSTEM AS SHOWN SHALL BE APPROVED BY "WINN-DIXIE" BEFORE WORK IS STARTED.
12. PLUMBING CONTRACTOR TO PROVIDE STOPS FOR WATER SUPPLIES AT EACH NEW PLUMBING FIXTURE.
13. ALL NEW WATER LINES ABOVE FLOOR SLAB SHALL BE INSULATED W/ 1" WALL THICK ARMSTRONG ARMAFLEX 22 OR APPROVED EQUAL. INSULATION SHALL BE FURNISHED & INSTALLED BY PLUMBING CONTRACTOR. PLUMBING CONTRACTOR SHALL INSTALL INSULATION AS RECOMMENDED BY INSULATION MANUFACTURER. GLUE ALL JOINTS. INSULATE ALL FITTINGS THAT ARE NOT CHROME PLATED.
14. N/A
15. PROVIDE & INSTALL ADEQUATE WATER HAMMER AND ANTI-SIPHON PROTECTION ON ALL NEW FAUCETS. SIZE IN ACCORDANCE WITH LOCAL CODES.

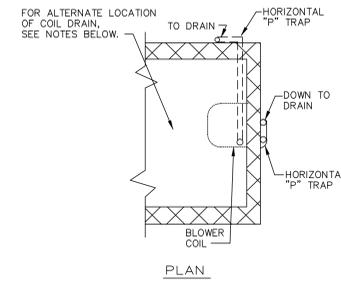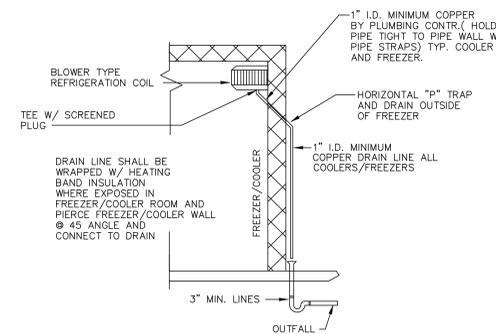


TYPICAL COOLER AND FREEZER DRAINS

NOTES:


1. SLOPE FLOOR FROM INSIDE COOLER WALLS TO FLOOR DRAINS OUTSIDE COOLERS.
2. SEE PLUMBING PLAN FOR NUMBER AND LOCATION OF BLOWER TYPE REFRIGERATION COILS. REFRIGERATION COILS ARE FURNISHED AND INSTALLED BY TENANT. PLUMBING CONTRACTOR SHALL MAKE ALL PLUMBING CONNECTIONS.
3. CONDENSATE DRAINS FOR FREEZERS SHALL BE LOCATED OUTSIDE FREEZER.

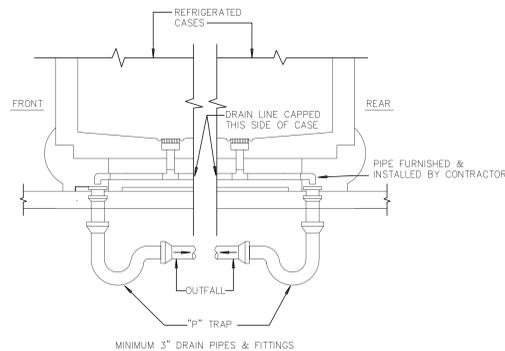


"DCD" CASE DRAIN SECTION

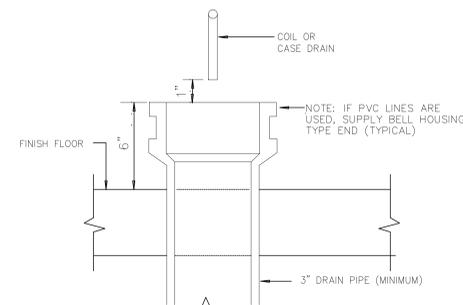


"CD" DRAIN

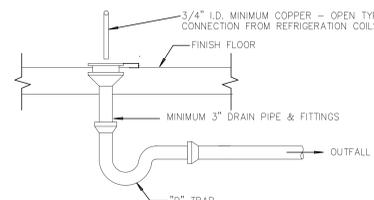


"CD" COIL DRAIN DETAILS

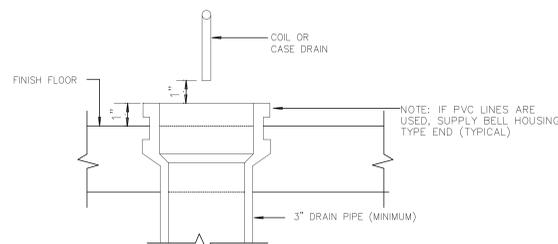


"DCD" DRAIN

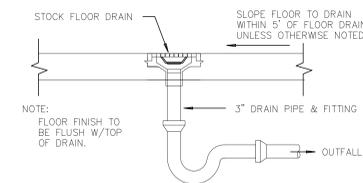

"FD" FLOOR DRAIN

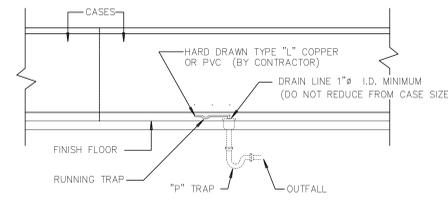

"DCD" CASE DRAIN

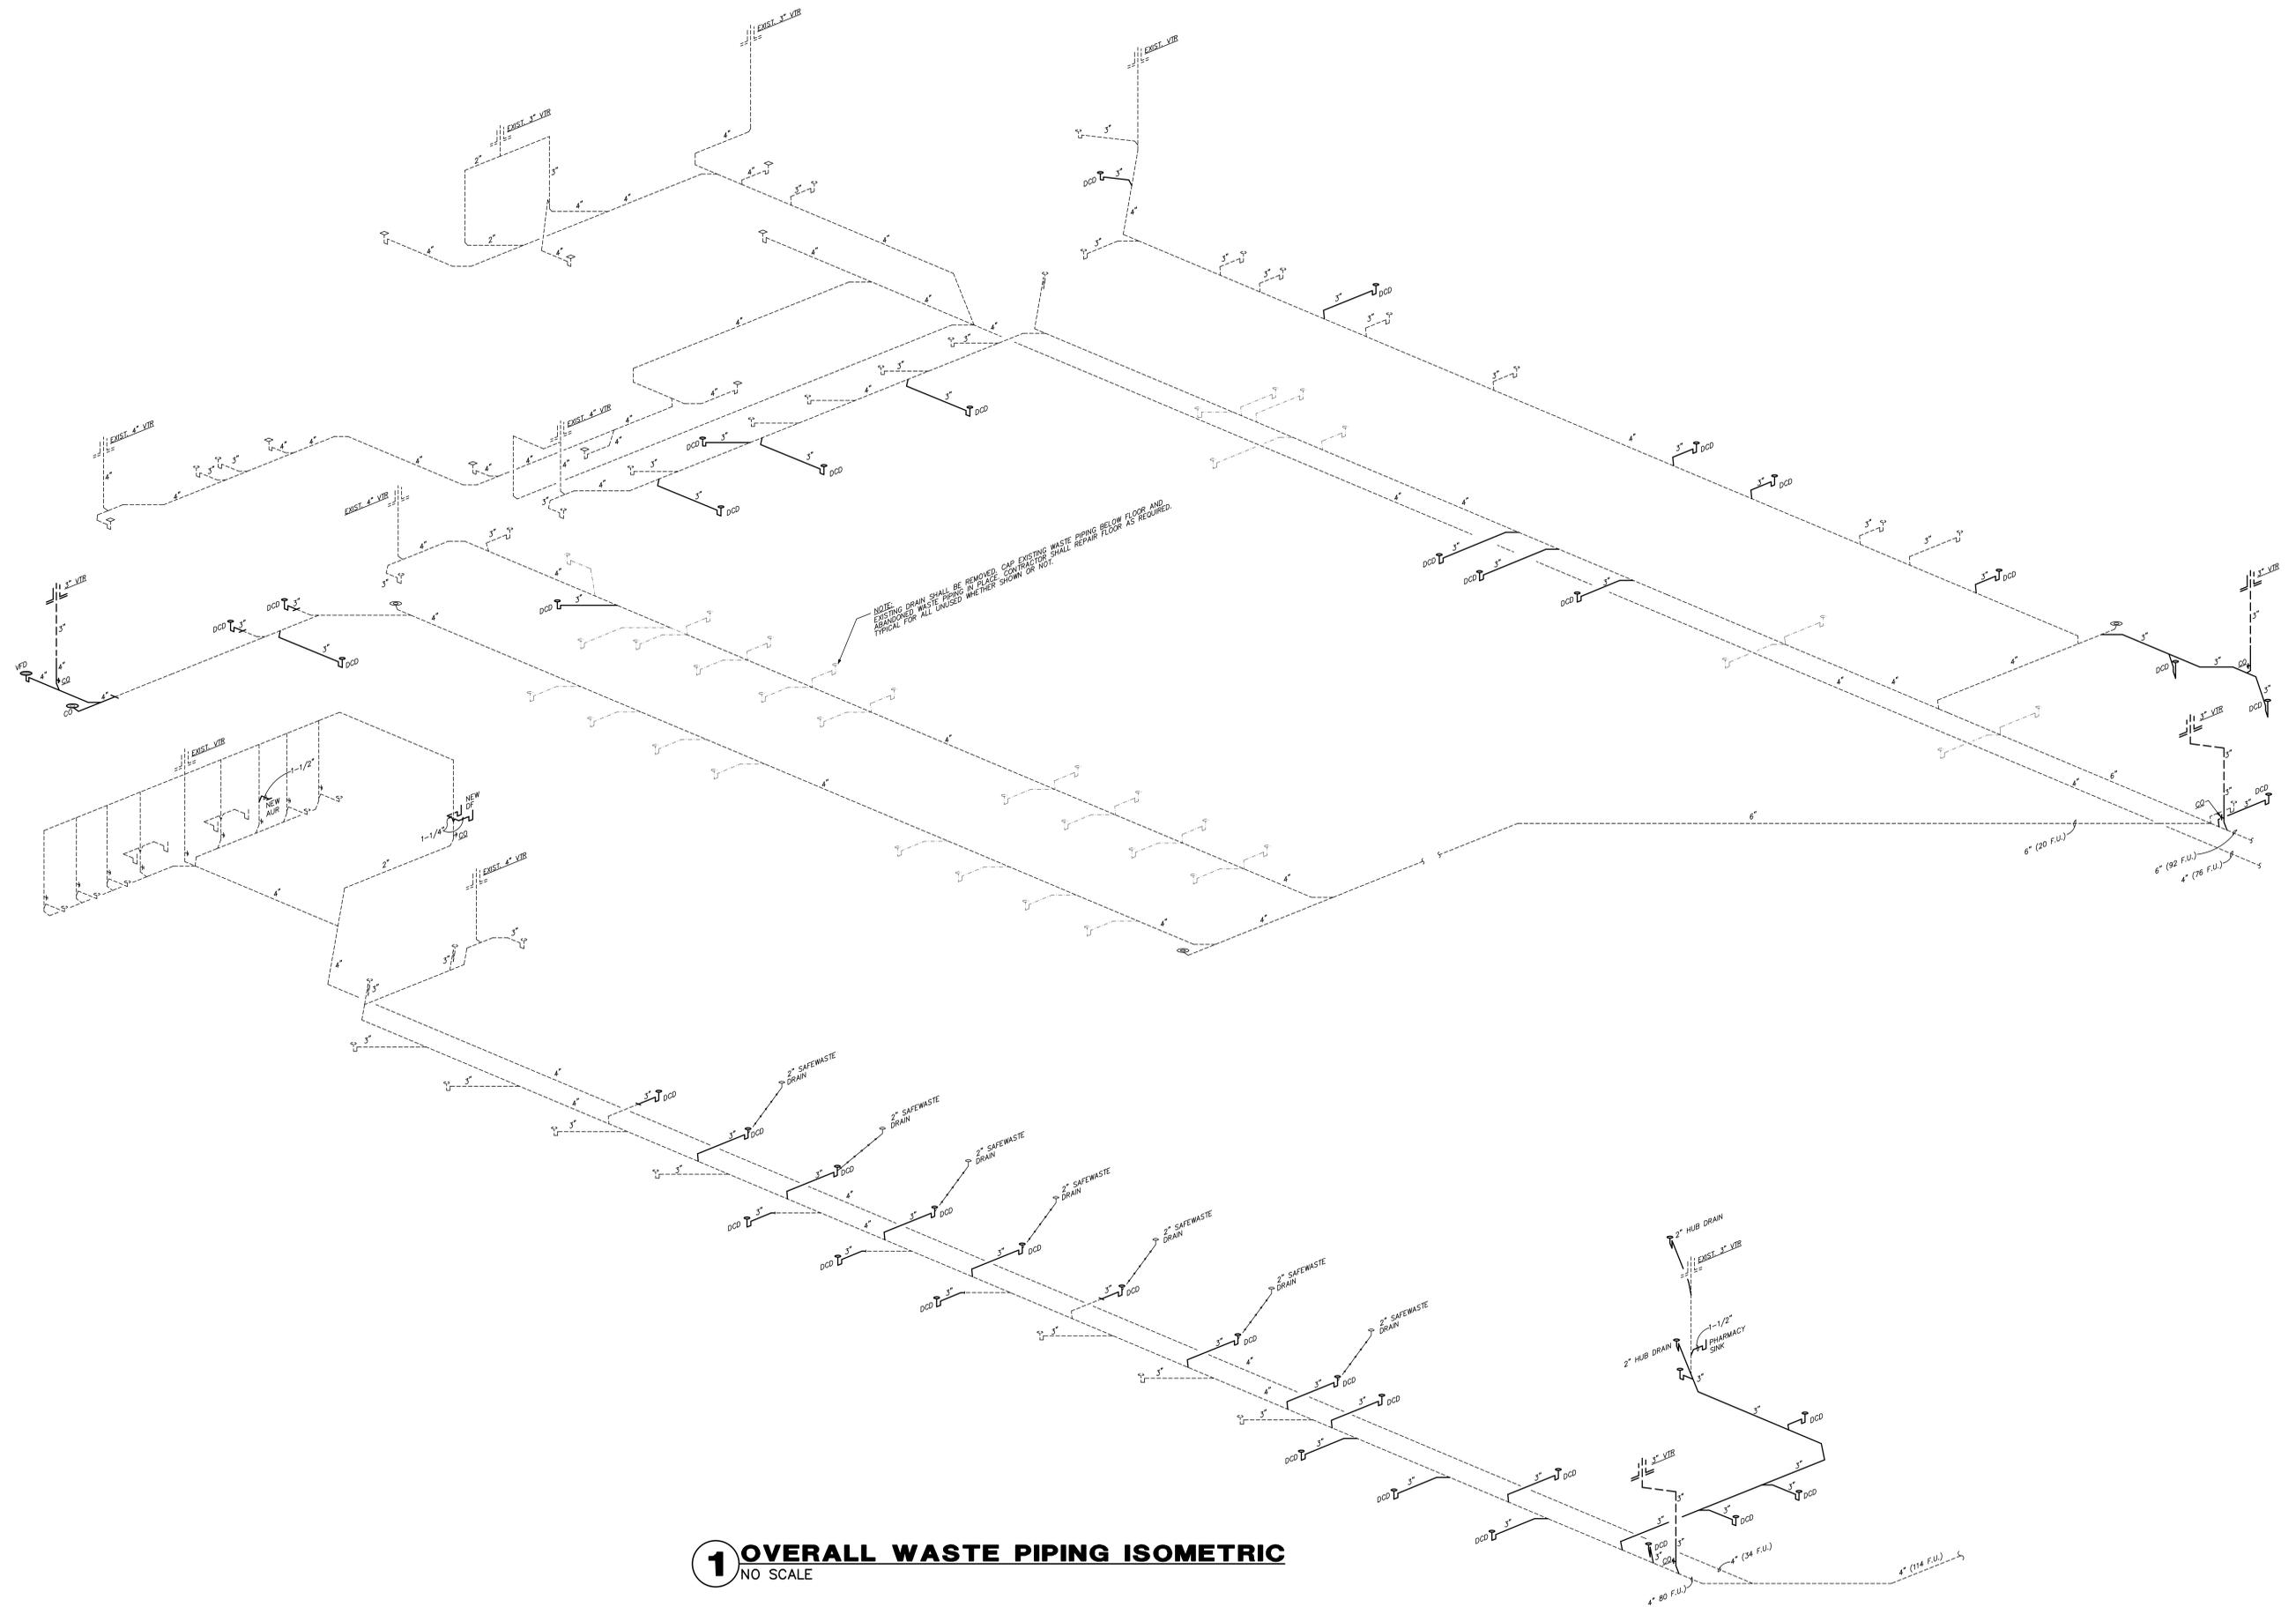

1 OVERALL WASTE PIPING ISOMETRIC
NO SCALE